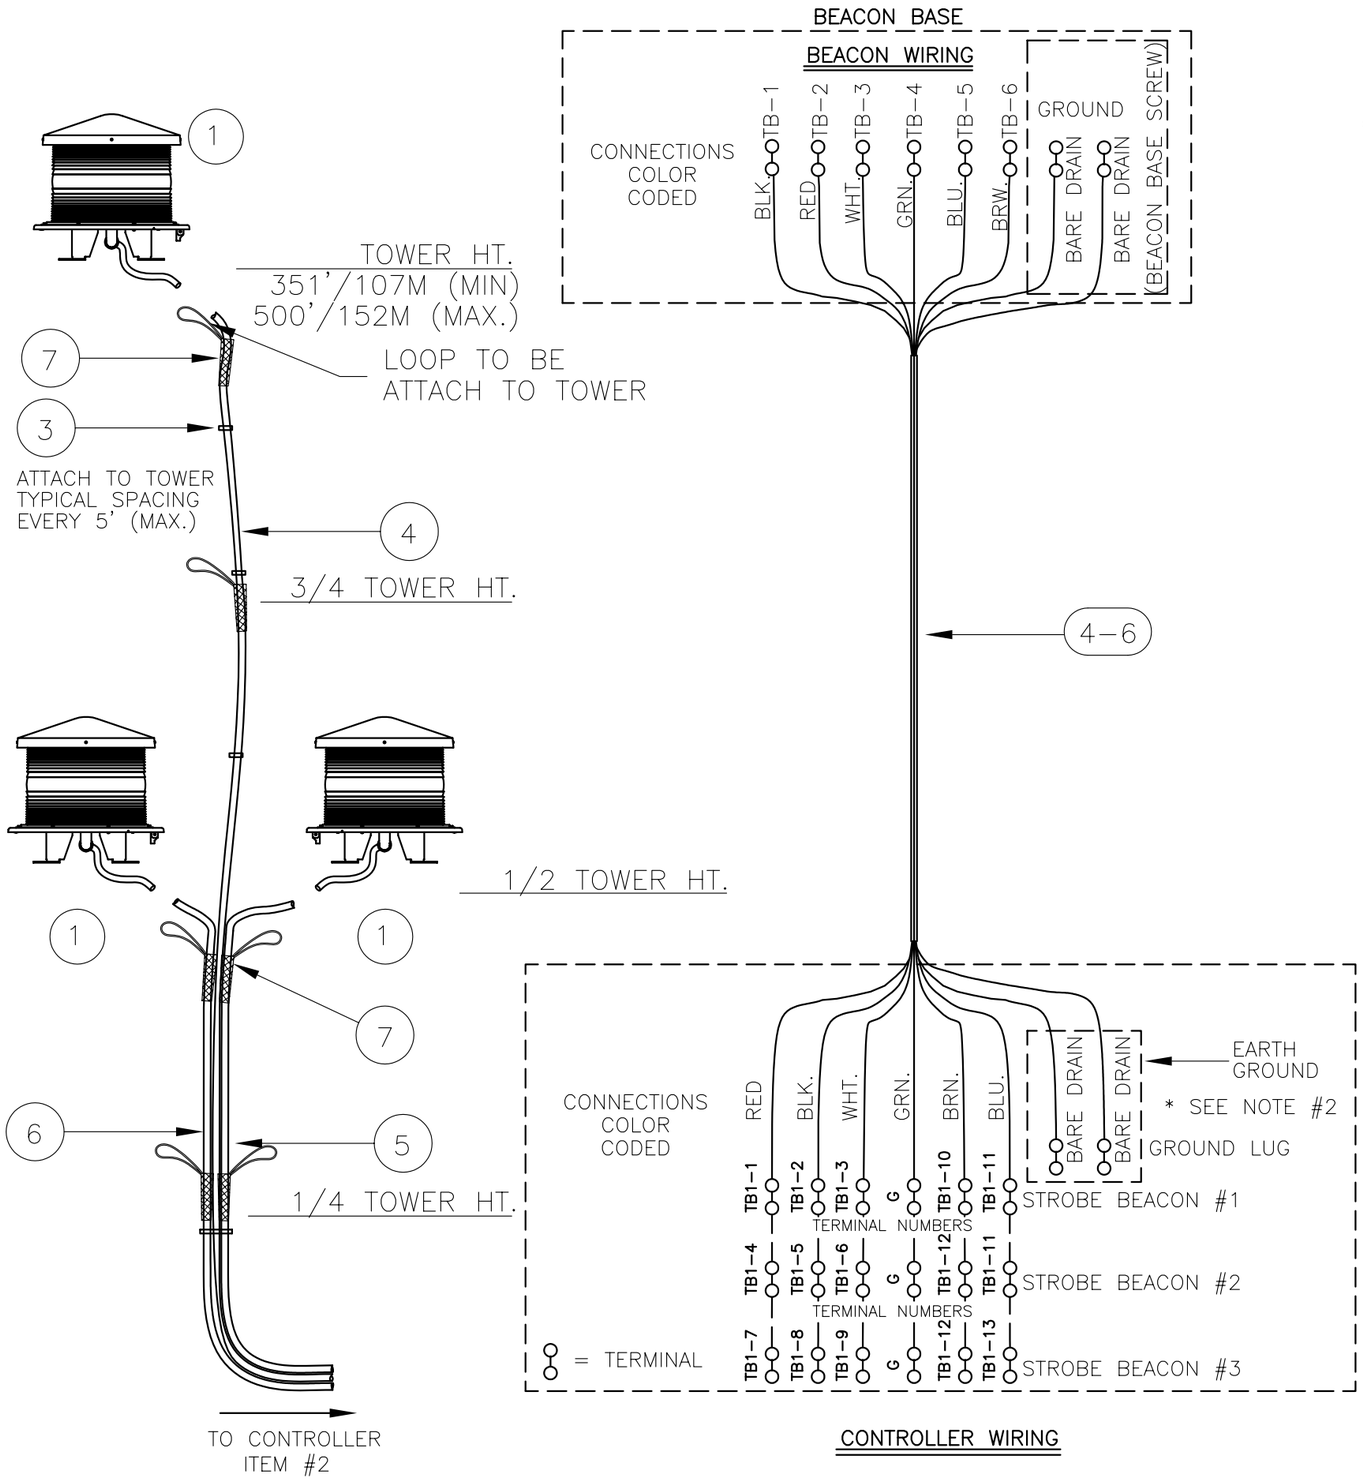

CONTROLLER WIRING

BILL OF MATERIALS

	ITEM NO.	QTY.	TWR PART NO.	DESCRIPTION
	1	3	STBEACON7	LVS STROBE BEACON
*	2	1	STH40285	D-2/3LVS CONTROLLER
	3	–	STCABLTIE	PRT5EH-CO PANDUIT CABLE TIE (TWR HT÷ 5 x 2)
	4	–	STROCABLE-2	6 CONDUCTOR CABLE (TWR HT + 30'/9M)
	5	–	STROCABLE-2	6 CONDUCTOR CABLE (1/2 TWR HT + 30'/9M)
	6	–	STROCABLE-2	6 CONDUCTOR CABLE (1/2 TWR HT + 30'/'9M)
	7	8	CABLGRIP1	SINGLE EYE LACE MESH .5 – .62

* = ITEMS NOT SHOWN

NOTES:

1) MOUNT BEACON HINGE SO LENS WILL OPEN UNOBSTRUCTED BY STRUCTURE.
2) ON AM RF TOWER APPLICATIONS, KEEP GROUND LUG FROM BEING CONNECTED TO EARTH GROUND. GROUND TO THE TOWER ONLY.
3) POWER SUPPLY IS NORMALLY MOUNTED AT EYE LEVEL ON TOWER. IT CAN ALSO BE MOUNTED INDOORS. RECOMMENDED MOUNTING HEIGHT IS 42" TO BOTTOM OF THE ENCLOSURE FOR EASE OF MAINTENANCE.
4) STROBE CABLE IS TO BE FASTENED TO TOWER STRUCTURE W/PART NUMBER STCABLTIE. (ATTACH EVERY 5')
5) THIS DRAWING IS PROVIDED AS A GENERAL REFERENCE. TWR LIGHTING, INC. DOCUMENTATION SUPERSEDES THIS DRAWING & SHOULD BE REVIEWED PRIOR TO INSTALLATION OF THIS SYSTEM.

DATE:	LTR.	REVISION
08/02/00	A	CHANGED B.O.M.

LK1D2/3LVS TOWER LIGHTING KIT

(CABLE RUN FOR 351'/107M TO 500'/152M TOWERS)

TWR Lighting, Inc.

APP'D	ENGINEER	CHK'D BY	
DRAWN BY: E.A.SALAZAR		SHEET SIZE: B	SHEET QTY.: 1 OF 1
DATE: 12/16/98	SCALE: N.T.S.	DRAWING NO.: 500-14	

NOTICE: This drawing is the property of TWR Lighting, Inc. All information contained herein that is not generally known shall be confidential except to the extent the information has been previously established. This drawing may not be reproduced, copied or used as the basis for manufacture or sale without written permission.